


MAR 02, 2009 2:55 PM WELLS00930\03\0085\03S140866-COMMAND POST\CADD\TYPE B1 DESIGN SERVICES\MECH\VENT\V101.DWG - A101

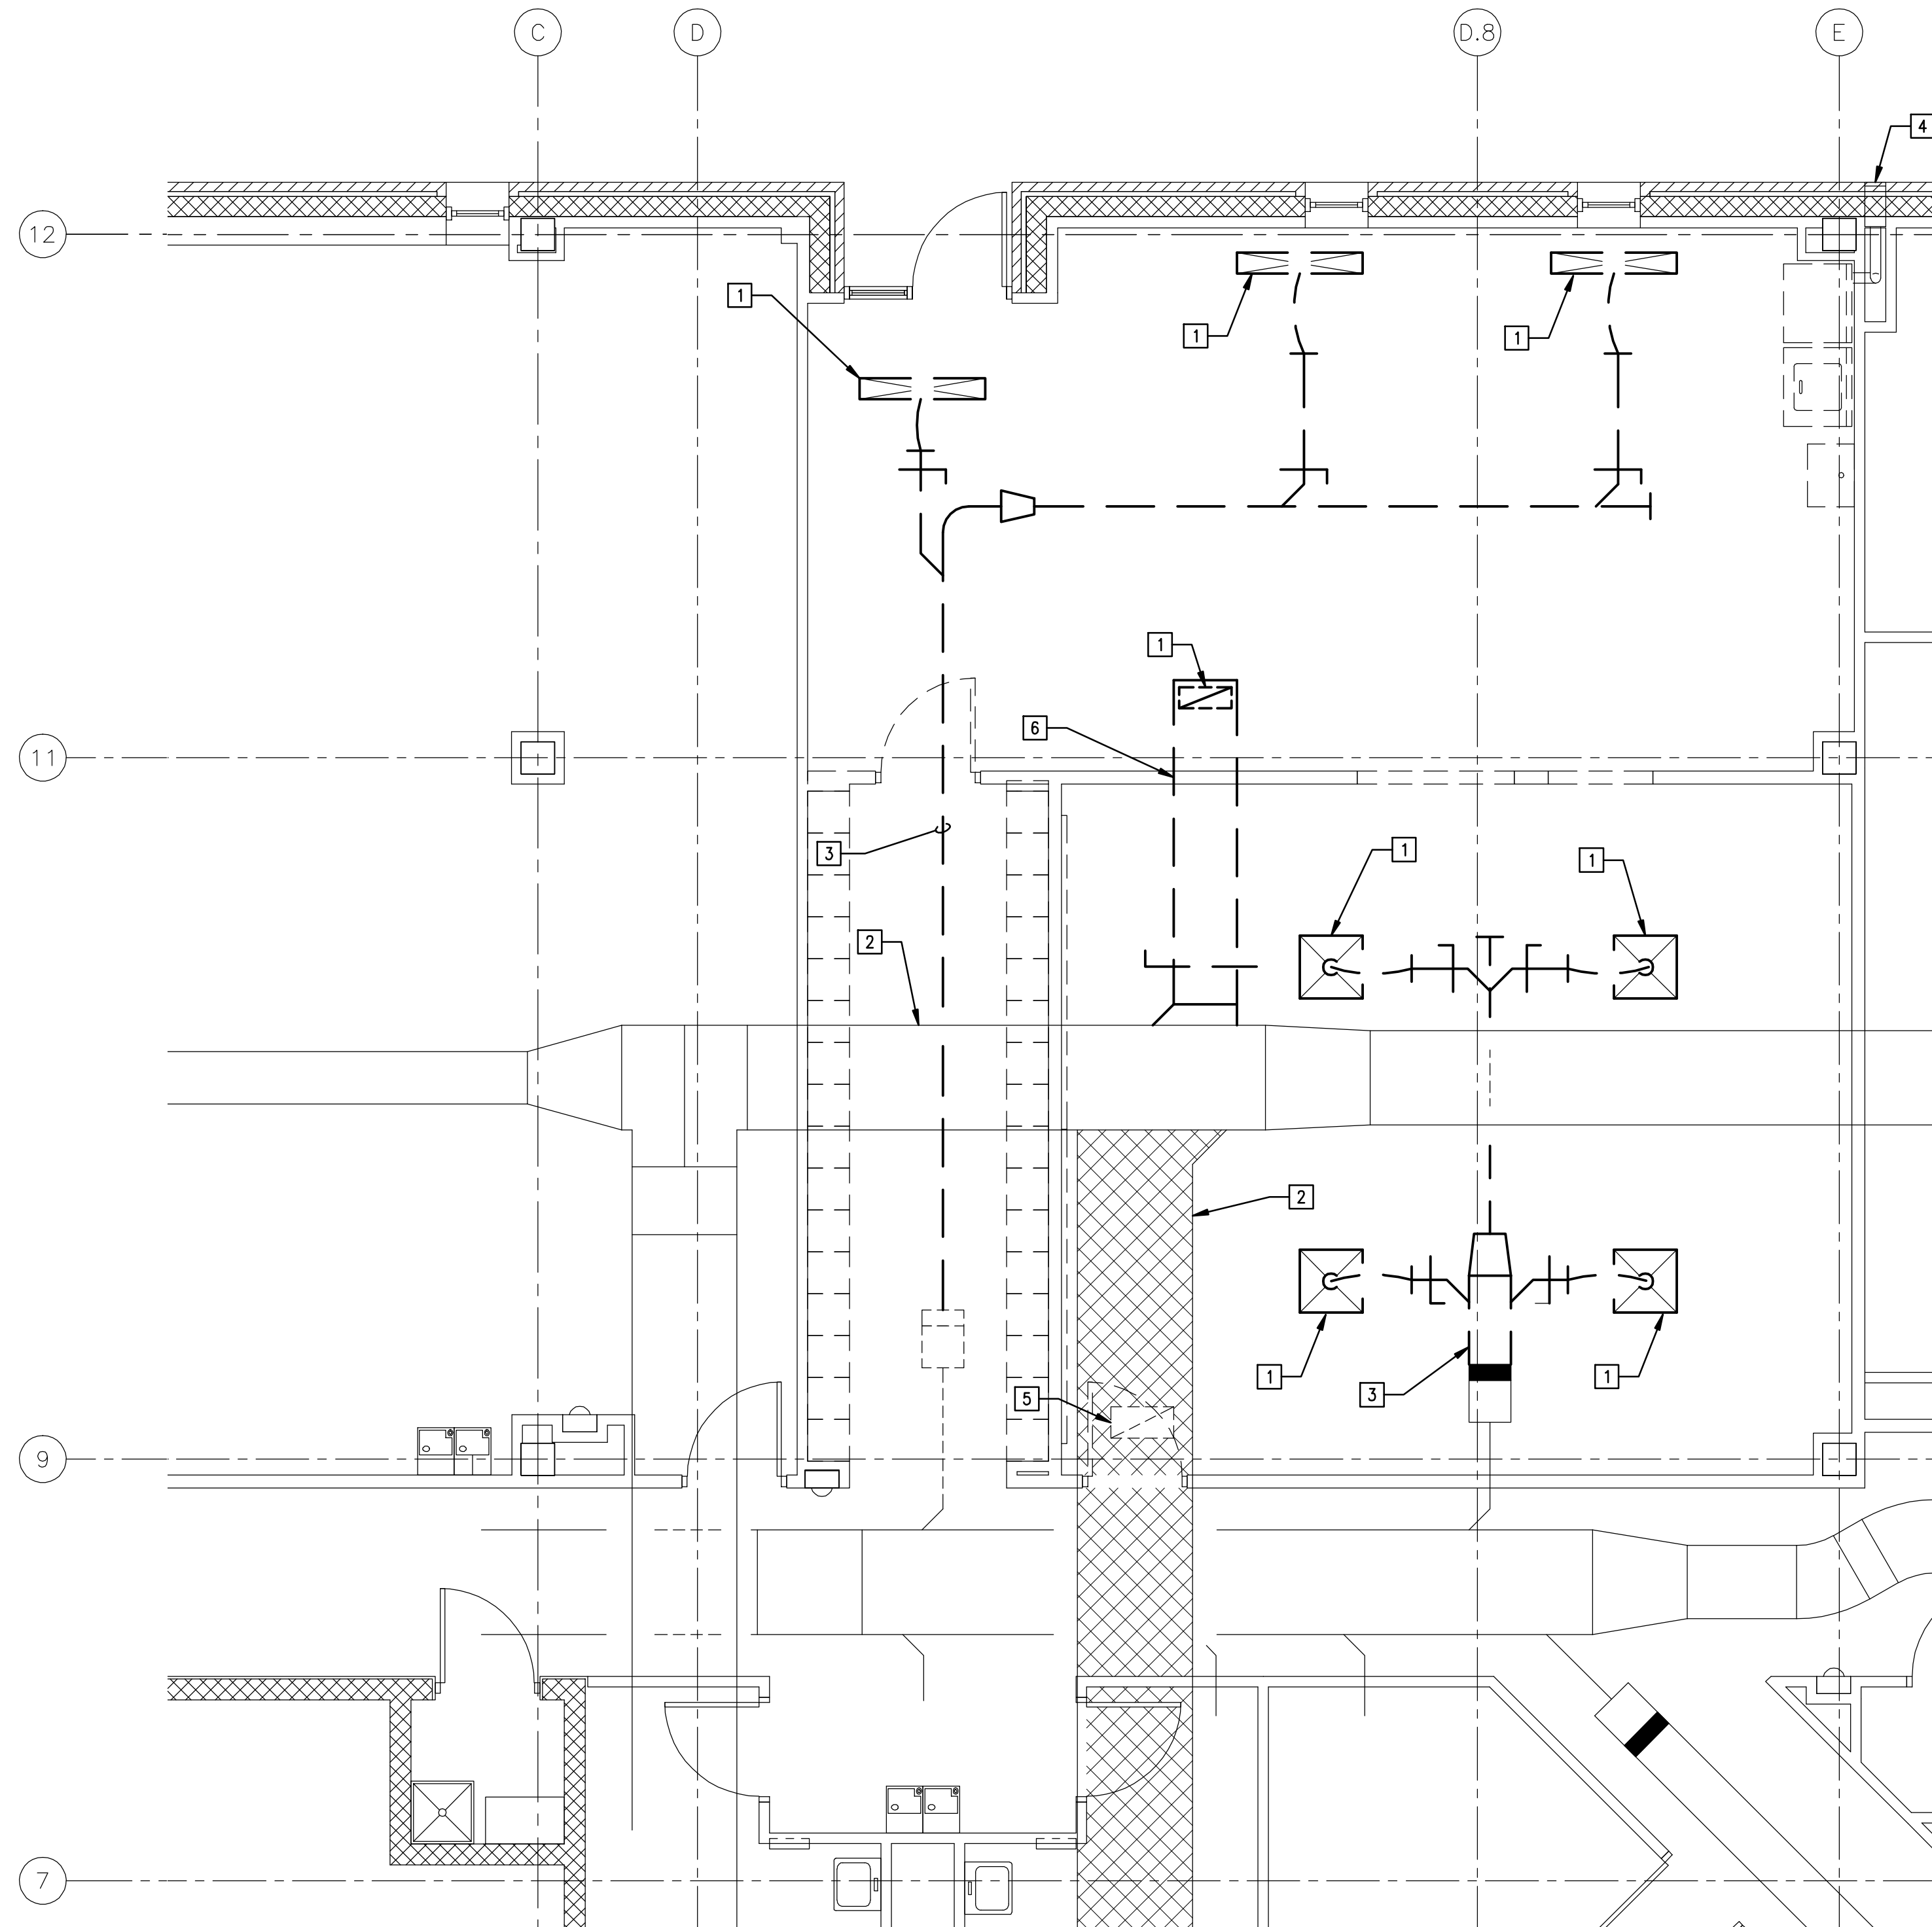

KEY NOTES – DEMOLITION:

- 1 REMOVE EXISTING SUPPLY/RETURN AIR DEVICES AND SAVE FOR REINSTALLATION AS SHOWN ON NEW WORK PLAN.
- 2 EXISTING RETURN DUCTS SHALL REMAIN.
- 3 DISCONNECT AND REMOVE SUPPLY DUCT DOWNSTREAM OF VAV BOX #107 & #108. NEW DUCTWORK SHALL BE PROVIDED AS SHOWN ON NEW WORK PLAN.
- 4 EXISTING WALL LOUVER AND DRYER VENT DUCT SHALL BE ABANDONED IN PLACE. CAP DRYER VENT DUCT.
- 5 REMOVE EXISTING RETURN AIR DEVICE AND CAP/SEAL OPENING ON MAIN RETURN DUCT.
- 6 REMOVE EXISTING RETURN AIR DUCT BACK TO MAIN. TEMPORARILY CAP OPENING IN MAIN. SEE NEW WORK PLAN FOR NEW DUCTWORK.

PARTIAL FIRST FLOOR PLAN - VENTILATION - DEMOLITION

0 2' 4' 8'  
SCALE: 1/4" = 1'-0"

DATE	REVISION



183rd Fighter Wing  
Illinois Air National Guard



HANSON PROJECT			
FILENAME V101.DWG			
SCALE 1/4" = 1'-0"			
DATE 03/02/09			
LAYOUT	HWH	8/12/08	
DRAWN	HWH	8/12/08	
REVIEWED	ATK	8/14/08	



Hanson Professional Services Inc.  
1525 South Sixth Street  
Springfield, Illinois 62703-2886

PARTIAL FIRST FLOOR PLAN  
DEMOLITION

COMMAND POST (CP) RELOCATION  
183D FIGHTER WING  
SPRINGFIELD, IL

V1.1